


Water Line Instructions

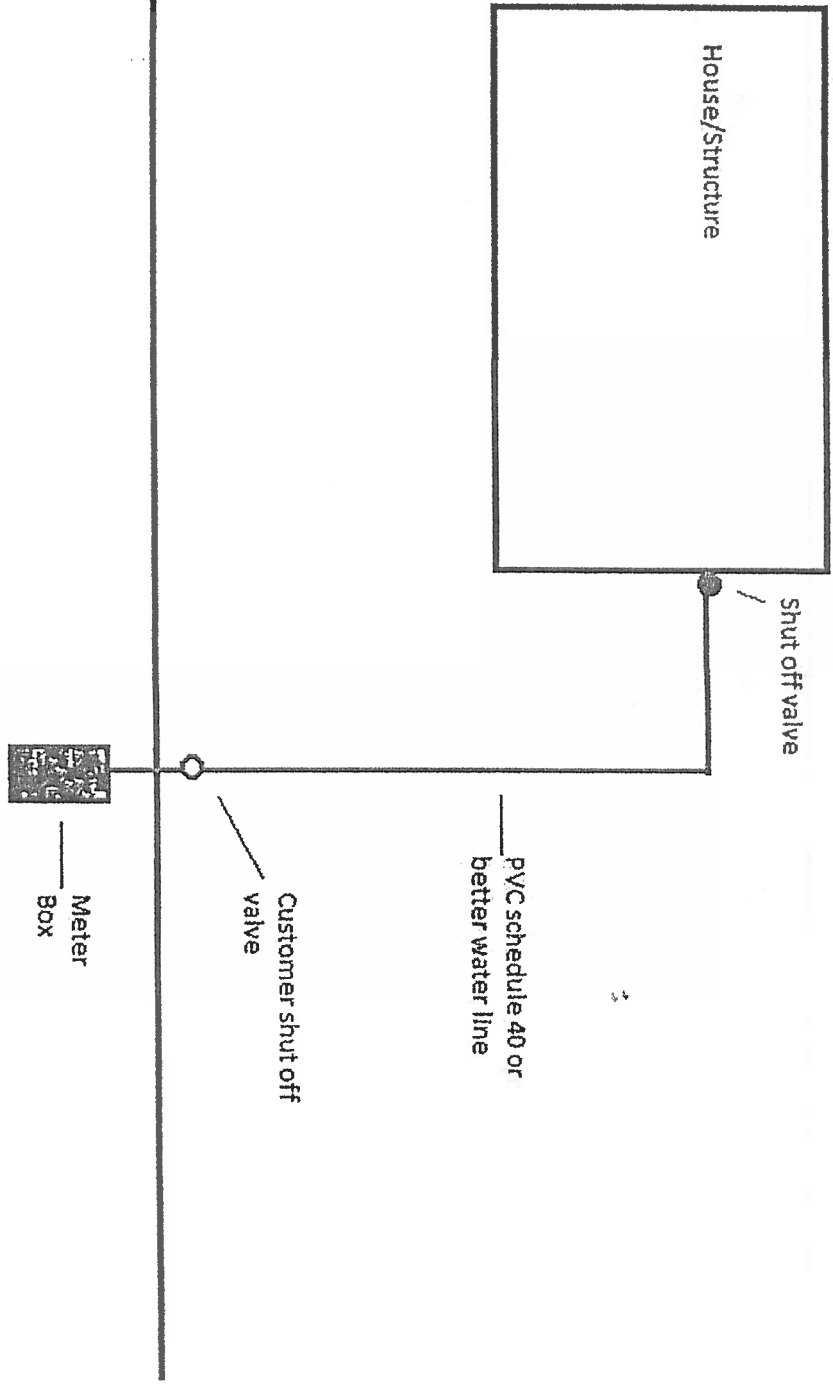

Waterline shall be PVC sch 40 or better.

Line size depends on size meter purchased.

Fraze line in East Texas is 8", Minimum depth shall be 10".

**** CUSTOMER MUST PROVIDE CUT OFF VALVE ON SERVICE LINE INSIDE METER BOX ****

Service line material shall be 4" (PVC) SDR 35 or greater pipe. Fittings shall be PVC gravity sewer fitting solvent weld (glued) or gasket joint. Schedule 40 pipe is acceptable

Clean outs shall be provided at 1 foot inside property line and within 5 feet of the house connection

The connection at the house may use a flex coupling type adapter only if the clamps are stainless steel and the body of the coupling is at least 4 inches long.

Pipe and fittings shall be primed and glued to manufactures instructions

